



# STF-502C series High Performance Dual Fiber Industrial Serial-to-Fiber Converter



## User's Manual

Version 1.1

## **LEGAL**

The information in this publication has been carefully checked and is believed to be entirely accurate at the time of publication. Our company assumes no responsibility, however, for possible errors or omissions, or for any consequences resulting from the use of the information contained herein. Our company reserves the right to make changes in its products or product specifications with the intent to improve function or design at any time and without notice and is not required to update this documentation to reflect such changes.

Our company makes no warranty, representation, or guarantee regarding the suitability of its products for any particular purpose, nor do we assume any liability arising out of the application or use of any product and specifically disclaims any and all liability, including without limitation any consequential or incidental damages.

Our products are not designed, intended, or authorized for use in systems or applications intended to support or sustain life, or for any other application in which the failure of the product could create a situation where personal injury or death may occur. Should the Buyer purchase or use our product for any such unintended or unauthorized application, the Buyer shall indemnify and hold Our company and its officers, employees, subsidiaries, affiliates, and distributors harmless against all claims, costs, damages, expenses, and reasonable attorney fees arising out of, either directly or indirectly, any claim of personal injury or death that may be associated with such unintended or unauthorized use, even if such claim alleges that we were negligent regarding the design or manufacture of said product.

## **TRADEMARKS**

Microsoft is a registered trademark of Microsoft Corp.

HyperTerminal™ is a registered trademark of Hilgraeve Inc.

## **WARNING:**

This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and if not installed and used in accordance with the instruction manual may cause harmful interference in which case the user will be required to correct the interference at his own expense. NOTICE: (1) The changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment. (2) Shielded interface cables and AC power cord, if any, must be used in order to comply with the emission limits.

## **CISPR PUB.22 Class A COMPLIANCE:**

This device complies with EMC directive of the European Community and meets or exceeds the following technical standard. EN 55022 - Limits and Methods of Measurement of Radio Interference Characteristics of Information Technology Equipment. This device complies with CISPR Class A.

## **WARNING:**

This is a Class A product. In a domestic environment this product may cause radio interference in which case the user may be required to take adequate measures.

## **CE NOTICE**

Marking by the symbol CE indicates compliance of this equipment to the EMC directive of the European Community. Such marking is indicative that this equipment meets or exceeds the following technical standards: EN55022 Class A, EN61000-4-2 ESD Level 3, EN61000-4-3 RS Level 3, EN61000-4-4 EFT Level 3, EN61000-4-5 Surge Level 3, EN61000-4-6 CS Level 3.

***Industrial Serial-to-Fiber Converter***

Industrial Grade RS-485 / RS-422 / RS-232 Fiber Media Converter

User Manual

Version 1.1 Sep 13, 2013

This manual supports the following models:

STF-502C series

This document is the current official release manual. Please check our website for any updated manual or contact us by E-mail.



<b>CHAPTER 1. INTRODUCTION .....</b>	<b>7</b>
1.1 WELCOME .....	7
1.2 PRODUCT DESCRIPTION .....	7
1.2.1 Features .....	7
1.2.2 Specifications .....	7
1.2.3 Block Diagram .....	8
1.2.4 Theory of Operation .....	9
1.2.5 Applications .....	9
1.2.6 RS-485 4 wire vs. 2 wire .....	9
1.2.7 RS-485 Termination .....	9
1.2.8 RS-485 Pull High, Pull Low .....	10
<b>CHAPTER 2. INSTALLATION.....</b>	<b>11</b>
2.1 DIN RAIL MOUNTING .....	11
2.1.1 Bracket Mounting.....	11
2.1.2 Rail Mounting .....	11
2.1.3 Rail Dismounting .....	12
2.2 WALL MOUNTING .....	12
2.3 ELECTRICAL INSTALLATION.....	13
2.3.1 DC Power.....	13
2.3.2 Alarm Contact.....	13
2.4 RS-485/422 CONNECTIONS .....	14
2.5 RS-232 CONNECTIONS .....	14
2.6 FIBER CONNECTIONS.....	14
<b>CHAPTER 3. CONFIGURATION AND OPERATION.....</b>	<b>15</b>
3.1 CONFIGURATION .....	15
3.1.1 DIP Switch .....	15
3.1.2 Pull High/Low .....	16
3.1.3 LED Definitions .....	16
3.2 OPERATION .....	17
3.2.1 Two Unit Point-to-Point without fiber protection .....	17
3.2.2 Two Unit Point-to-Point with fiber protection .....	17
3.2.3 Three or more units Daisy Chain .....	18
3.2.4 Three or more units Ring Topology .....	18

This page left blank intentionally

## Chapter 1. Introduction

### 1.1 Welcome

Thank you for purchasing our STF-502C series dual fiber port serial media converter. This media converter is an "industrial strength" product that employs rugged mechanical materials and construction, component selection for wide temperature, highly reliable and long life operation and an electrical design that prevents internal damage or data disruption from surges, power spikes or other electromagnetic interference.

### 1.2 Product Description

The STF-502C series is an industrial grade fiber media converter that provides dual fiber connections to extend asynchronous RS-232, RS-485 or RS-422 serial transmissions over a distance of up to 2km using multimode fiber or up to 60km using single mode fiber. The dual fiber inputs allow connecting multiple devices in a cascade or "daisy chain" fashion as well as creating ring architecture for fiber redundancy. The converter is capable of selecting interface modes for connection to RS-232 (3 wire), RS-485 (2 wire, half duplex) or RS-422/485 (4 wire, full duplex). The STF-502C series secures asynchronous serial data transmissions over EMI resistant fiber at speeds up to 1024kbps; and features an alarm relay contact and two redundant DC power inputs. It is designed for industrial automation applications running smoothly and continuously. This series comes with two operating temperature ranges, a standard 0° to 60°C commercial temperature range or an extended -40° to 75°C range in -T models.

#### 1.2.1 Features

- Extends serial transmissions up to 2km, 30km or 60km
- Supports fiber daisy chain or ring connections
- Redundant dual power inputs 12/24/48VDC
- Supports dual fiber link redundancy
- Supports RS-422, RS-485(2/4 wire), and RS-232 transmission to dual fiber connections.
- Enhanced serial baud rate up to 1024kbps (RS-422/485) or 230.4kbps (RS-232)
- 2.5KV isolation for serial signals
- Supports relay output for power or fiber link failure warning
- Hardened housing with IP30 protection
- Fan-less and DIN-Rail design for harsh industrial environments
- Adjustable pull high/low resistor and terminator for RS-422/485 transmission

#### 1.2.2 Specifications

##### Optical Interface

Connector :	SC or ST
Fiber Optical data rate :	50.000Mbps
Fiber Optical line coding :	4B5B + NRZI
Fiber Port :	Two fiber ports
Fiber Type :	MM 2km or SM 30km/60km (duplex fiber)
Wavelength :	MM 1310nm, SM 1310, 1550nm
Point to Point Transmission :	Half or Full duplex
Ring Transmission :	Half / Full duplex, self-healing

##### Electrical Interface

Serial Connectors :	RS-422/RS-485(5 pin terminal) RS-232(DB9 Female) RS-485 : 4, 2 wires, RS-422 : 4 wires, RS-232 : 3 wires RS-485 direction : Automatic detection
Copper Baud rate :	50 to 1024Kbps(RS-422/485), 230.4Kbps(RS-232-CH1), 115.2Kbps(RS-232-CH2)
Serial Isolation :	2.5KV for serial signals
Surge Protection :	8KV ESD for serial signals
Pull High/ Pull Low :	selected by 10 position rotary switches
120 ohm terminator :	Option by Dip switch

**Alarm Contact**

One relay output with current carrying capacity of 0.5A @ 125VAC or 1A @ 30 VDC (resistive)

**Power**

Power Input : 12, 24, 48 VDC (9.6 ~ 58VDC absolute)  
 Power Consumption : 5W  
 Power Reversal Protection : Yes  
 Over Current Protection : Signal Short Together Protected  
 Terminal Block for Power and Alarm : Yes

**Physical Characteristics**

Metal Housing  
 Water & Dust : IP30 Protection Rating  
 Dimensions : 106 x 39 x 142mm (D x W x H)  
 Net Weight : 720g  
 Mounting : DIN-Rail mounting, Wall Mounting (kits included)

**Environmental Limits**

Operating Temperature:  
     Standard Temperature Model: 0°C ~ 60°C (32 to 140°F)  
     Wide Temperature Model: -40°C ~ 75°C (-40 to 167°F)  
 Storage Temperature: -40 to 85°C (-40 to 185°F)  
 Relative Humidity: 5 ~ 95%


**Certifications**

Safety : UL508 (Pending)  
 EMC : CE, FCC  
 EMI : EN55022 Class A  
 EMS: EN61000-4-2 ESD Level 3  
       EN61000-4-3 RS Level 3  
       EN61000-4-4 EFT Level 3  
       EN61000-4-5 Surge Level 3  
       EN61000-4-6 CS Level 3  
 Free Fall : IEC 60068-2-32  
 Vibration : IEC 60068-2-6  
 Shock : IEC 60068-2-27  
 Green : RoHS  
 MTBF : 797,101 Hrs

**1.2.3 Block Diagram**

The STF-502C series has a configurable 2-wire / 4-wire RS-485/422 interface and two RS-232 3-wire interfaces. The two RS-232 interfaces share a common ground but are isolated from power ground and from the RS-485/422 interface by 2.5KV isolation. The RS-485/422 interface is also isolated from power ground and from the RS-232 signals by 2.5KV isolation.

An interface converter, with isolation, is created between the RS-422/485 and Channel 1 RS-232. The second RS-232 channel is independent and can carry data separately from the first channel.

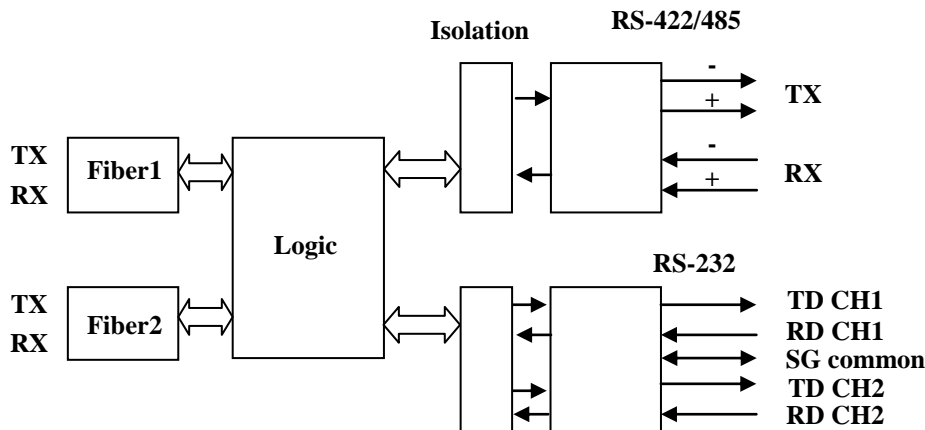

Basic block diagram of STF-502C series (for reference only)



### **1.2.4 Theory of Operation**

The STF-502C series uses control logic to connect an RS-485/422 interface, two RS-232 3-wire interfaces and two optical fiber channels; and units are interconnected by the fiber channels and can form point-to-point, cascaded (linear) or ring topologies. The STF-502C series uses Master/Slave hierarchy where only one master unit exists and all other units are slave in the application. In an 'idle' condition, all interfaces are in a listening state. When any unit's "receive interface" receives data transmission, it will broadcast and transmit the data out across all units' "transmit" interfaces. The STF-502C series operates completely at the physical layer, transparent to communication protocols. The communication protocols are required to handle bi-directional data flow control and device addressing.

### **1.2.5 Applications**

RS-485 signals are used in a wide range of computer and automation systems. RS-485 is used for low-speed data communications and the physical layer underlying many standard and proprietary automation protocols used to implement Industrial Control Systems, including the most common versions of Modbus and Profibus. The Profibus (Process Field Bus) protocol uses RS-485 physical medium when deploying field bus solutions in factory and process automation environments. Since RS-485 signals are differential, they resist external electromagnetic interference from motors and welding equipment.

In theatre and performance venues, RS-485 networks are used to control lighting and other systems using the DMX512 protocol.

In surveillance, RS-485 is used to control pan tilt zoom (PTZ) cameras via Panasonic, Pelco D/P, Samsung and Sony protocols.

RS-485 is also used in building automation as the simple bus wiring where long cable length is ideal for joining remote devices. RS-485 may be used to control video surveillance systems or to interconnect security control panels and devices such as alarm sensors, intrusion devices or access control card readers.

The STF-502C series uses a complete galvanic ally isolated full duplex RS485/RS422 transceiver. Coupled inductors and an isolation power transformer provide 2500VRMS of isolation between the line transceiver and the logic interface. This converter is ideal for systems where the ground loop needs to be broken to allow for large common mode voltage variation.

### **1.2.6 RS-485 4 wire vs. 2 wire**

RS-485 is a multipoint specification and uses a half-duplex, 2-wire communication connection. RS-485 drivers need to be put in transmit mode explicitly by asserting a signal to the driver. When not transmitting, the drivers present a high impedance on the wire pair. The protocol layer must handle transmission to avoid two devices "talking" at once.

When switching the RS-485 to 4-wire mode, we actually are making an RS-422 interface which is full duplex and with separate TX and RX wire pairs. In 4-wire mode, the transmit drivers are always enabled. This means that 4-wire mode is only applicable for point-to-point applications and cannot be used in multipoint applications.

### **1.2.7 RS-485 Termination**

Depending on the wire gauge of the cable and the materials used in the insulation, twisted-pair wire has "characteristic impedance" associated with it that is usually specified by the cable manufacturer. The RS-485 specification recommends, but does not specifically dictate, that this "characteristic impedance" be 120Ω.

Because of the high frequencies and the distances involved, proper attention must be paid to transmission-line effects. A detailed discussion of transmission-line effects and proper termination techniques is well beyond the scope of this user manual. With this in mind, terminations will be briefly discussed in their simplest form as they relate to RS-485.

A terminating resistor is simply a resistor placed at the extreme end or ends of a cable. The value of the terminating resistor is ideally the same value as the characteristic impedance of the cable. In the STF-502C series, this value is fixed at 120Ω.

When no termination resistance is applied to the wiring, reflections will occur as the signal travels down the cable. Although some reflections are inevitable due to cable and resistor tolerances, large enough mismatches can cause reflections big enough to cause errors in the data.


Knowing this, it is important to match the terminating resistance and the characteristic impedance as closely as possible. The position of the terminating resistors is also very important. As a general rule, termination resistors should be placed at both far ends of the cable. Although properly terminating both ends is absolutely critical for most system designs, it can be argued that in one special case only one termination resistor is needed. This case occurs in a system when there is a single transmitter and that single transmitter is located at the far end of the cable. In this case there is no need to place a termination resistor at the end of the cable with the transmitter, because the signal is intended to always travel away from this end of the cable.

### 1.2.8 RS-485 Pull High, Pull Low

Somewhere along the set of wires, pull up or pull down resistors are established to fail-safe bias of each data line/wire when the lines are not being driven by any device. This way, the lines will be biased to known voltages and nodes will not interpret the noise from un-driven lines as actual data. Without biasing resistors, the data lines may float in such a way that electrical noise sensitivity is greater when all device stations are silent or unpowered.

The STF-502C series uses rotary switches to select from ten different bias resistor values. The factory default setting is at position 4. The factory default provides bias resistors of 1KΩ in the pull high and pull low positions. When changing the rotary switches, it is important to maintain the same setting on both switches.

The following electrical circuit shows the locations of the pull high, pull low bias resistors, the terminating resistor and the relationship of transmitter and receiver in a 2-wire half duplex RS-485 application.

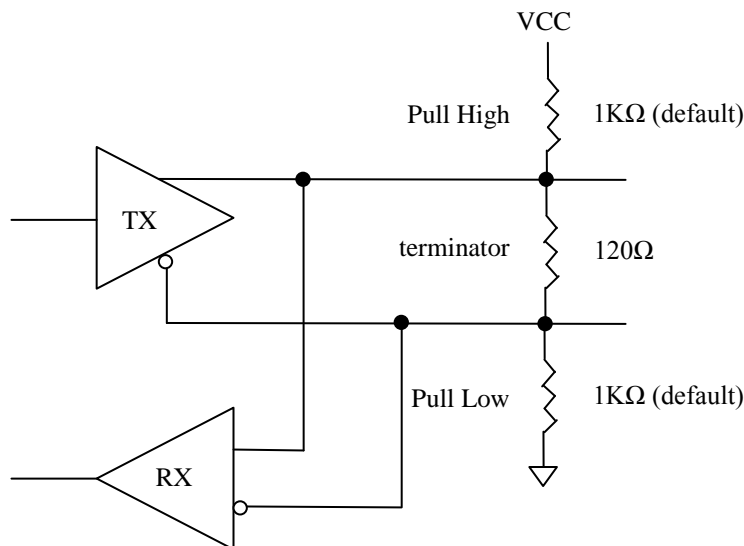

Pull High / Pull Low Bias Resistors and Termination


## Chapter 2. Installation

The STF-502C series offers two mounting options; DIN Rail mounting or Wall mounting. For each, a different mounting bracket is required. Both mounting option brackets are included.

### 2.1 DIN Rail mounting


#### 2.1.1 Bracket Mounting

To support DIN Rail mounting, the STF-502C series must first have the DIN Rail bracket installed. Position the bracket, as shown below, and use the two provided flathead screws to attach the bracket to the center two mounting holes. Note the alignment pin of the bracket must align with the hole in the STF-502C series.

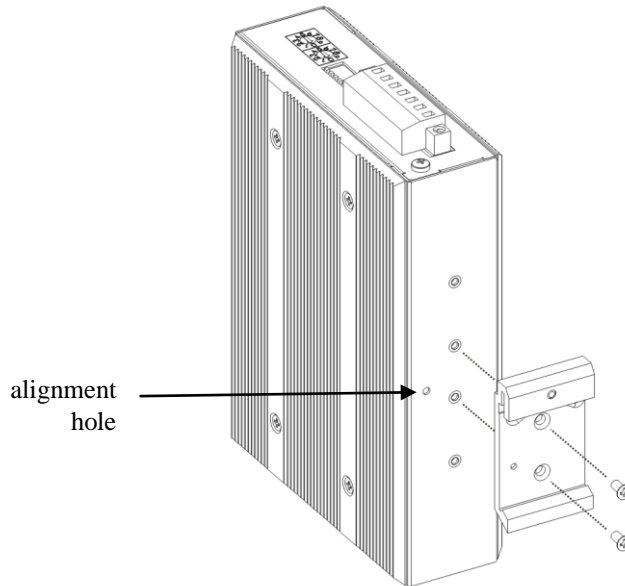

#### 2.1.2 Rail Mounting


Place the STF-502C series bracket over the top rail of DIN rail. Swing the unit into position [1] and snap the unit in place by placing a slight downward pressure [2] until the bottom of the bracket locks with the lower rail.

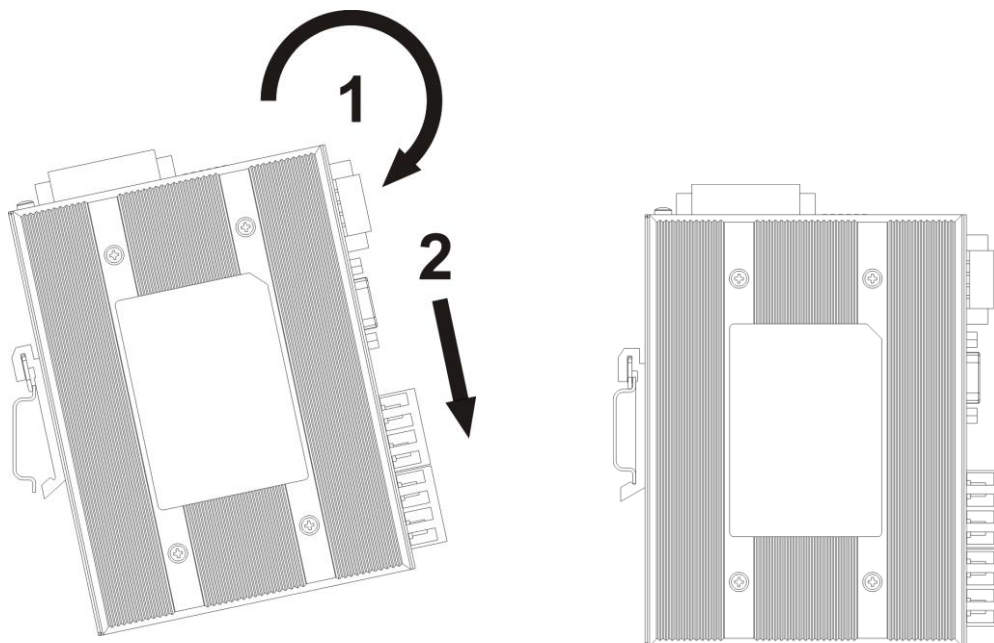

Rail mounting the STF-502C series

### 2.1.3 Rail Dismounting


To remove the STF-502C series unit, use a slight downward pressure [1] and release the lower rail from the unit's bracket. Swing the unit out [2] and lift off and away from the DIN rail.

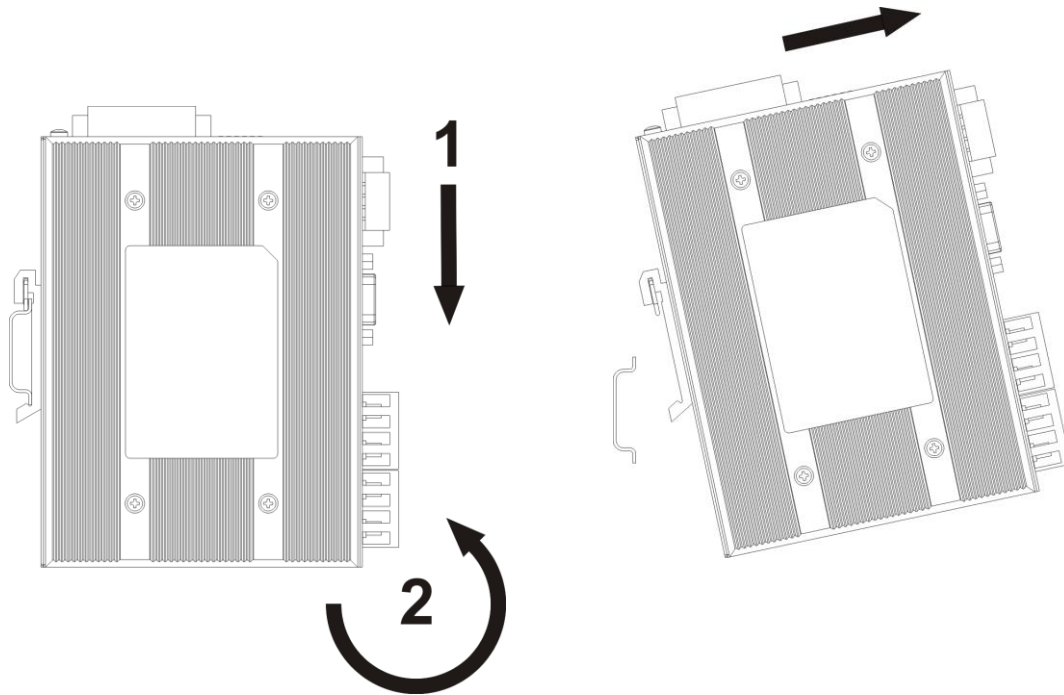

Rail dismounting the STF-502C series

### 2.2 Wall mounting

To support wall mounting, the STF-502C series must first have the wall mount bracket installed. You may use the bracket as a template for locating and drilling (if necessary) the wall mounting holes, prior to assembly. After preparing the wall mount location, attach the wall mount bracket to the unit, as shown below. Use the two provided flathead screws to attach the bracket to the outer two mounting holes.

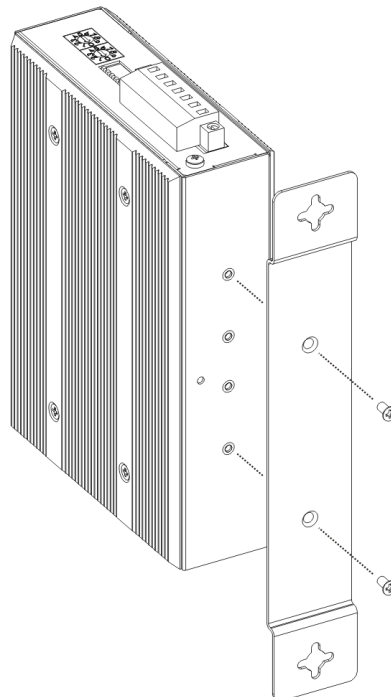

The wall mount bracket is attached with two screws


### 2.3 Electrical Installation

The electrical, signal and optical connections will be explained here. The DC power, alarm and RS-485 connections all use terminal blocks. A flat blade screwdriver (with blade width of ~2 mm) is required to secure the wiring in the terminal blocks.

#### 2.3.1 DC Power

There are input connectors for two power sources. Only one power source is required for normal operation. The second power source input may be provided for redundancy. When operating in a critical environment, connecting to two separate power sources will ensure non-stop operation even in the event that one power source fails.


The power inputs are protected against reverse polarity connections, in fact they will actually work if power is reverse connected. However, we highly recommend following the proper polarity connection for power. Not all devices are designed with such protection features as the STF-502C series.

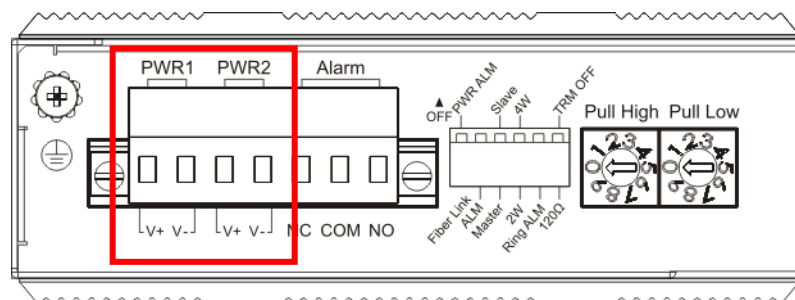

Physical connections for two power inputs

#### 2.3.2 Alarm Contact


The STF-502C series has a single, normally open / normally closed alarm relay contact. Depending on some DIP switch settings, this alarm contact can create a closed or open circuit when conditions such as power failure or fiber disconnect occurs. The alarm contact is capable of carrying up to 1A @ 24VDC and can be used to complete or break a circuit for a visible or audible alarm.

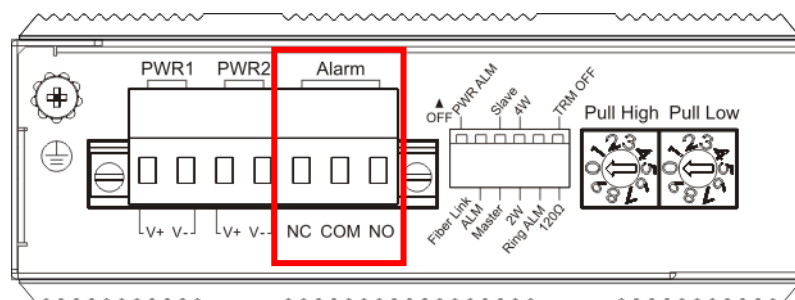

Physical connections for relay contacts

### 2.4 RS-485/422 Connections


The STF-502C series provides terminal connections for the twisted pair RS-485 interface wiring. When using 4-wire RS-485 or RS-422, connect transmit and receive pairs as indicated in the table under "4-Wire Mode". When using 2-wire RS-485, connect the single wire pair with the polarity indicated in the table under "2-Wire Mode".

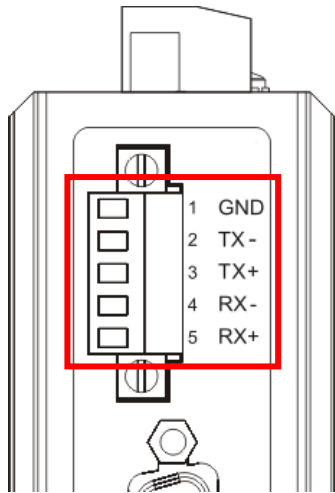

Pin	4-Wire Mode	2-Wire Mode
1	Ground	Ground
2	TX- (transmit minus)	-----
3	TX+ (transmit plus)	-----
4	RX- (receive minus)	TRX- (Tx/Rx minus)
5	RX+ (receive plus)	TRX+ (Tx/Rx plus)

### 2.5 RS-232 Connections

The STF-502C series uses a 9 pin D-Sub female connector for RS-232 connections. This D-Sub connects to one RS-232 channel (using only 3-wire) by the standard pins 2(TD), 3(RD) & 5(SG). A second RS-232 channel uses non-standard pin assignment, utilizing the pins normally used for handshaking, 7(RD), 8(TD) & 5(SG).

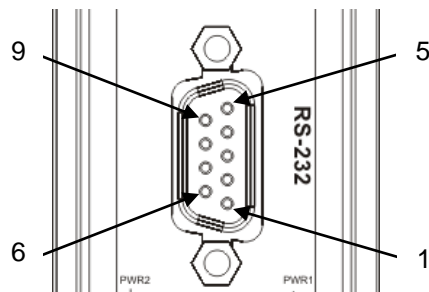


Pin	Function
1	
2	Ch1 TD
3	Ch1 RD
4	
5	GND
6	
7	Ch2 RD
8	Ch2 TD
9	

### 2.6 Fiber Connections

The STF-502C series is available with fiber connectors for SC or ST and for multi-mode or single mode fiber. The fiber connections require duplex cables and proper adherence to connections for RX and TX. The following table describes the attributes of the various transceivers available for the STF-502C series.

Connector Type	Wavelength	Media	Optical TX Power	Optical RX Sensitivity	Power Budget	Distance	Diode
SC or ST	1310nm	MMF	-14~-20dBm	-31dBm	11dB	2KM	VCSEL
SC or ST	1310nm	SMF	-5~-15dBm	-35dBm	20dB	30KM	FP
SC or ST	1310nm	SMF	0~-5dBm	-35dBm	30dB	60KM	FP

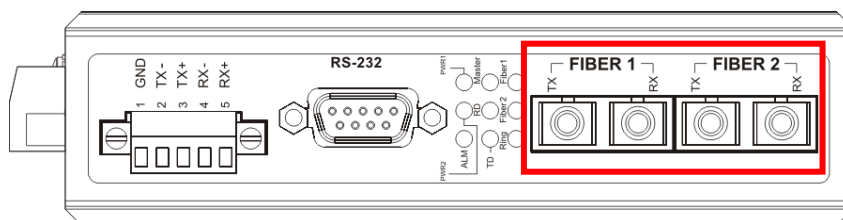


## Chapter 3. Configuration and Operation

### 3.1 Configuration

#### 3.1.1 DIP Switch

The STF-502C series uses a 6-pole DIP (dual inline package) switch and two 10-position rotary switches for all configuration settings. There is no provision for any software configuration.

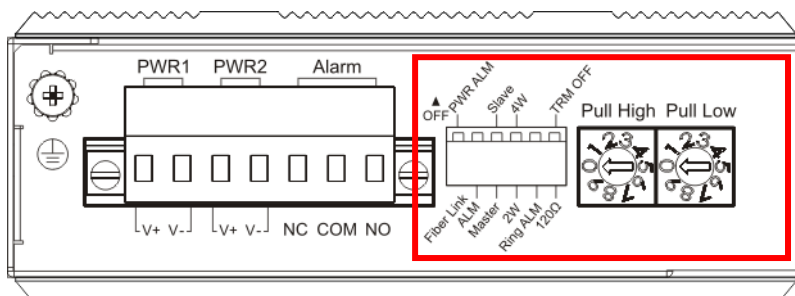

The DIP switch sets the operational mode, configures alarm and interface operation, while the rotary switches are used exclusively for the pull high, pull low bias resistors in the RS-422 (RS-485) receive circuits.

Sw	Position	Function	
1	OFF	Loss either input power, no alarm	
	ON	Loss either input power, alarm active	
2	OFF	Loss either fiber link, no alarm	
	ON	Loss either fiber link, alarm active	
3	OFF	Operation Mode	Slave
	ON		Master
4	OFF	RS-485 Mode	4-Wire
	ON		2-Wire
5	OFF	Ring Alarm	Disable
	ON		Enable
6	OFF	Termination (RS-485)	OFF
	ON		120Ω

Switch 1 : When connecting the STF-502C series to only a single power source, leave this switch OFF or the alarm will be constantly on. When connecting to two separate power sources, turn this switch ON and alarm will occur if either power source fails.

Switch 2 : When connecting the STF-502C series to only a single optical connection, leave this switch OFF or the alarm will be constantly on. When connecting both fiber ports, turn this switch ON and alarm will occur if either fiber link fails.

Switch 3 : In any application, using two or more STF-502C series, one unit should be set to 'Master' mode and all other units must be set to 'Slave'.

Switch 4 : This switch sets the RS-485 to either 2-wire or 4-wire operation. In 2-wire operation, connect the wire pair to only the RX+ and RX- connections.


Switch 5 : This switch should only be enabled when the STF-502C series has its fiber connected in a ring topology. Then, when enabled, if any break occurs in the fiber ring, the alarm is become active. For point-to-point or linear topology, disable this switch or alarm will be constantly active.

Switch 6 : This switch enables the internal signal termination by placing a 120 ohm resistance across the RX complimentary pair. (Refer to Chapter 1 [Section 1.2.7](#) for more detailed description of termination.)

3.1.2 Pull High/Low

The pull high / pull low bias is explained in more detail in Chapter 1 [Section 1.2.8](#). The bias resistance should be set to position setting no.4 for 1KΩ from the factory. It is highly recommended to set both high and low rotary switches to the same setting. Using different settings will put an unequal bias on the circuit and could cause more noise by unbalancing the common-mode rejection capability of the balanced transmission wire pair.


The following graphic shows the two Pull High, Pull Low rotary switches in the no. 0 position. The table lists the bias resistor values for the rotary switch positions.

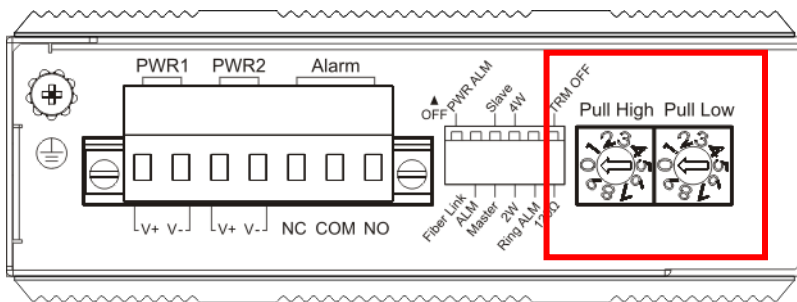

Position	Resistance (Ohms)
0	100K
1	9.9K
2	5K
3	3.3K
4	1K (default)
5	920
6	840
7	774
8	500
9	475

3.1.3 LED Definitions

The front panel has a 3 x 3 matrix of 2.5mm LEDs. The LEDs are used to quickly diagnose the link and alarm condition of the STF-502C series.

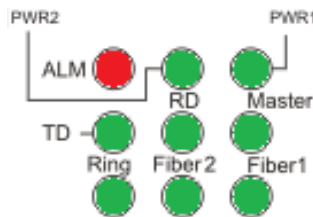

The following table lists and describes the meanings of the LEDs.

LED	Color	State	Definition
ALM	Red	OFF	Normal operation with no alarms
		ON	Alarm exists for power, fiber link or ring protection**
PWR2	Green	OFF	There is no DC power at PWR2 input
		ON	DC power normal at PWR2 input
PWR1	Green	OFF	There is no DC power at PWR1 input
		ON	DC power normal at PWR1 input
TD	Green	OFF	Transmit data is idle (Mark)
		ON	There is data transmitted (Space)
RD	Green	OFF	Receive data is idle (Mark)
		ON	There is data being received (Space)
Master	Green	OFF	Configured in Slave mode
		ON	Configured in Master mode
Ring	Green	OFF	Ring failure
		ON	Ring OK
Fiber2	Green	OFF	Fiber 2 has no link
		ON	Fiber 2 has optical link
Fiber1	Green	OFF	Fiber 1 has no link
		ON	Fiber 1 has optical link

\*\* Depends on the settings of DIP switch 1, 2 & 5 for alarm reporting.



## 3.2 Operation

The following examples are for reference and as an aid in understanding the operating modes and DIP switch selections of the STF-502C series converter.

### 3.2.1 Two Unit Point-to-Point without fiber protection

In the very simplest application, a duplex fiber connects two STF-502C series units. One unit is set as 'Master' the other as 'Slave'. The RS-485 and RS-232 are completely isolated electrically. A receive signal can only be connected to either the RS-485 (terminal block) or to the RS-232 DB9 (not both at the same time). That received signal will be transmitted simultaneously on every transmit connection, both RS-485 and RS-232.


In the example below, the 'Master' unit is receiving RS-485 serial signal. The signal is repeated out of every other transmit pin.



### 3.2.2 Two Unit Point-to-Point with fiber protection

In the application with fiber protection, two duplex fibers connect the two STF-502C series units. One unit is set as 'Master' the other as 'Slave'. The RS-485 and RS-232 are completely isolated electrically. A receive signal can only be connected to either the RS-485 (terminal block) or to the RS-232 DB9 (not both at the same time). That received signal will be transmitted simultaneously on every transmit connection, both RS-485 and RS-232.


In the example below, the 'Master' unit is receiving RS-485 serial signal. The signal is repeated out of every other transmit pin.

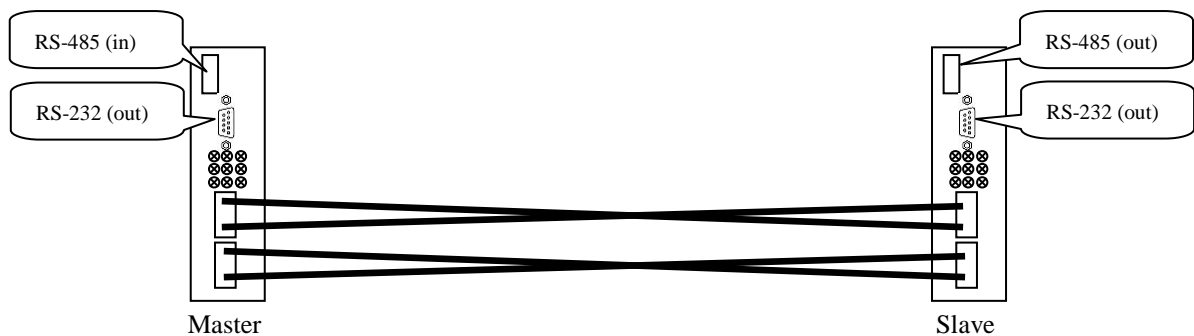


3.2.3 Three or more units Daisy Chain

In the application with three or more units in a daisy chain, duplex fibers connect the STF-502C series units. One unit is set as 'Master' the others as 'Slave'. The RS-485 and RS-232 are completely isolated electrically. A receive signal can only be connected to either the RS-485 (terminal block) or to the RS-232 DB9 (not both at the same time). That received signal will be transmitted simultaneously on every transmit connection, both RS-485 and RS-232.

In the example below, the 'Master' unit is receiving RS-232 serial signal. The signal is repeated out of every other transmit pin of every other interface.

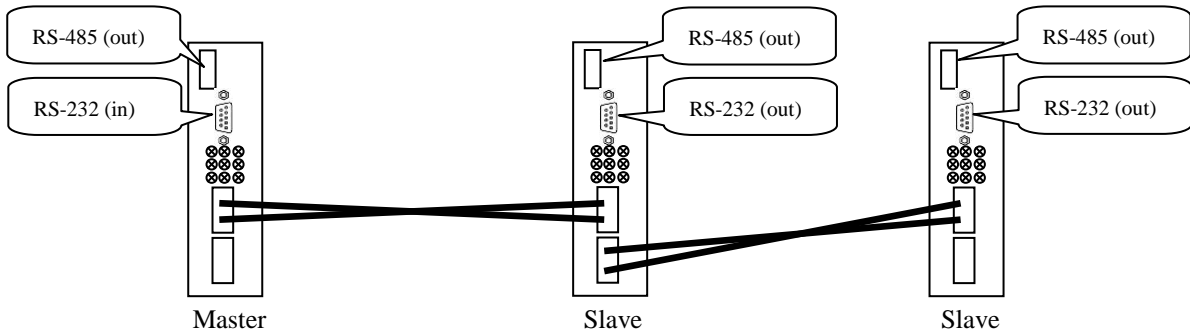

3.2.4 Three or more units Ring Topology

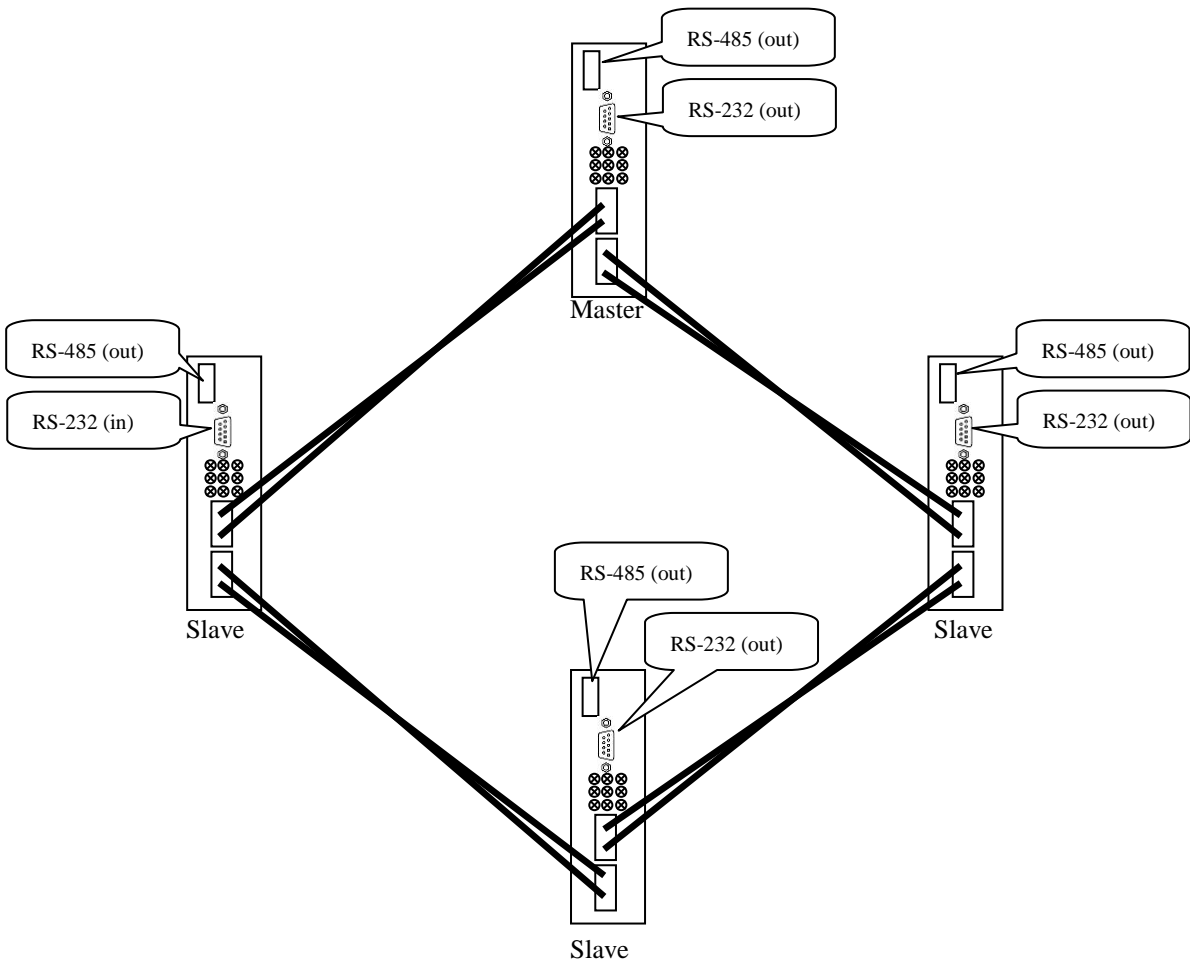

The information contained in this document is the property of Antaira Technologies, LLC and is supplied for the sole purpose of operation and maintenance of products of Antaira Technologies, LLC. No part of this publication is to be used for any other purposes, and it is not to be reproduced, copied, disclosed, transmitted, stored in a retrieval system, or translated into any human or computer language, in any form, by any means, in whole or in part, without the prior written consent of Antaira Technologies, LLC.

**Published by**

Antaira Technologies, LLC

Toll-Free: 1-877-229-3665

e-Mail: [info@antaira.com](mailto:info@antaira.com)

Website: [www.antaira.com](http://www.antaira.com)

Copyright © 2013 Antaira Technologies, LLC. All rights reserved.

All other product names referenced herein are registered trademarks of their respective companies.

